
Utility Box Locations & Measurements


Attached is a list of Utility Boxes for the project. 10 Locations will be selected. Manufacture and City Measurements are included. Selected Service Providers should also physically measure the selected locations before printing to verify exact measurements. Please consult map that is also attached in this exhibit.

	Manufacturer	City Measu	irements (in	ches)
Location	Drawing#	Width	Height	Depth
1. Swede Alley & 4th	1	67	44 1/4	60 7/8
2. Swede Alley & 5th (2 boxes)	1	67	44 1/4	60 7/8
3. Swede Alley & Heber Ave	1	67	44 1/4	60 7/8
4. Park Ave, South of DV Dr.	1	67	44 1/4	60 7/8
5. 224 Corner South of Police Of	fice 1	67	44 1/4	60 7/8
6. Quinn's Junction	1	67	44 1/4	60 7/8
7. Bonanza & Prospector	1	67	44 7/16	61
8. Across from A-Fresh	1	67	44 1/4	61
9. DV Drive Split	1	67	44 3/8	61
10. Kearns & Comstock (west)	1	67	44	61
11. Kearns & Comstock (East)	2	75	44 7/8	73 1/8
12. Corner by New Urgant Care I	Bldg. 3	75	44 5/8	67 1/8



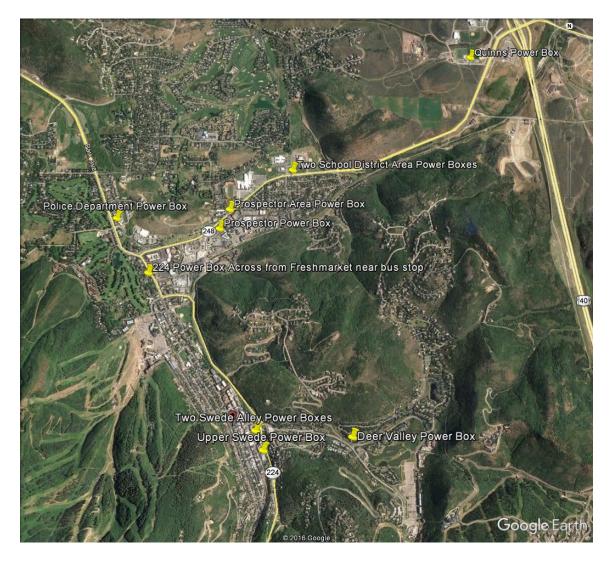

Model PMH-9 14.4 kV and 25 kV Nominal

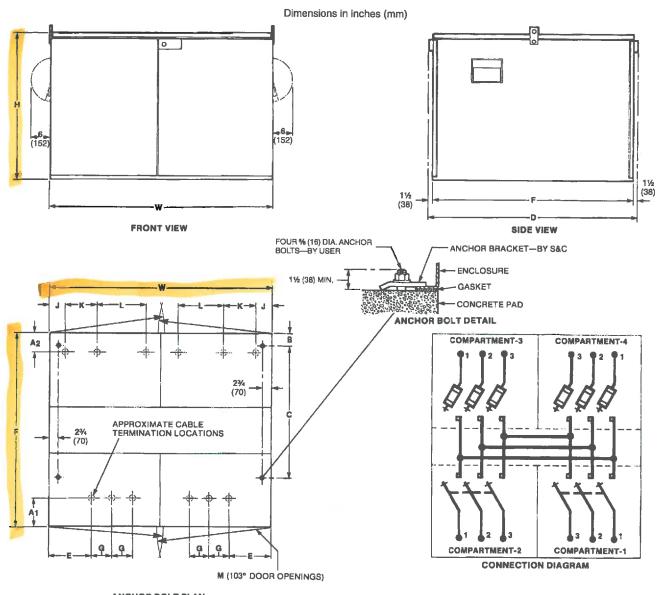


AN	CH	OR	801	LT	PLAN

kV, Nominal	A ₁ +	A ₂	В	С	D	E	F	G	Н	J	к	Ļ	М	w
14.4	9%	7	5½	40	63¾	121/8	60¾	6	44	4¾	9¾	14¾	34	67
	(251)	(178)	(130)	(1016)	(1619)	(327)	(1543)	(152)	(1118)	(121)	(248)	(375)	(864)	(1702)
25	14½	11¼	7½	62½	79¾	13¾	76¾	7½	55	6	12½	16½	41½	82
	(359)	(286)	(181)	(1588)	(2026)	(349)	(1949)	(191)	(1397)	(152)	(318)	(419)	(1054)	(2083)

When Catalog Number Suffix "-M1," "-U2," or "-U3" is specified, cable-termination locations will be slightly affected. Consult your nearest S&C Sales Office for details.



Model PME-11

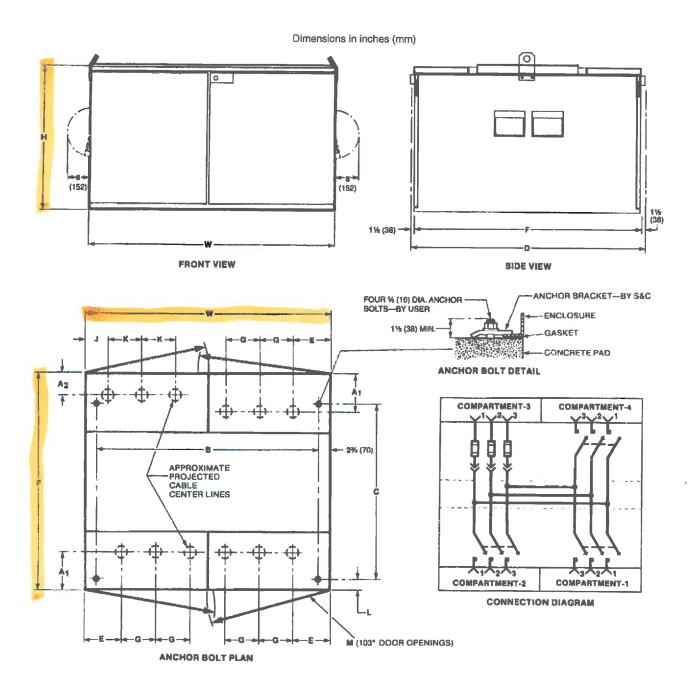


kV, Nominal	A ₁ ◆	A ₂ ◆	В	С	D	Ε	F	G	Н	J	K	L	М	W
14.4	14½	7	69½	55½	75¾	12¾	72¾	8¼	45.5	5%	10¾	8%	38	75
	(368)	(178)	(1765)	(1 76 5)	(1924)	(314)	(1848)	(210)	(1156)	(137)	(273)	(219)	(965)	(1905)
25	18½	81/s	78½	58½	91¼	12%	88¼	8¼	51.5	6	12	14%	42½	84
	(470)	(206)	(1994)	(1468)	(2318)	(327)	(2242)	(210)	(1308)	(152)	(305)	(378)	(1080)	(2134)

Projected cable center lines are applicable for PME models with cable installed in a cable pit. For cable installed in conduit, refer to pages 22 and 23.

#3

Model PME-9

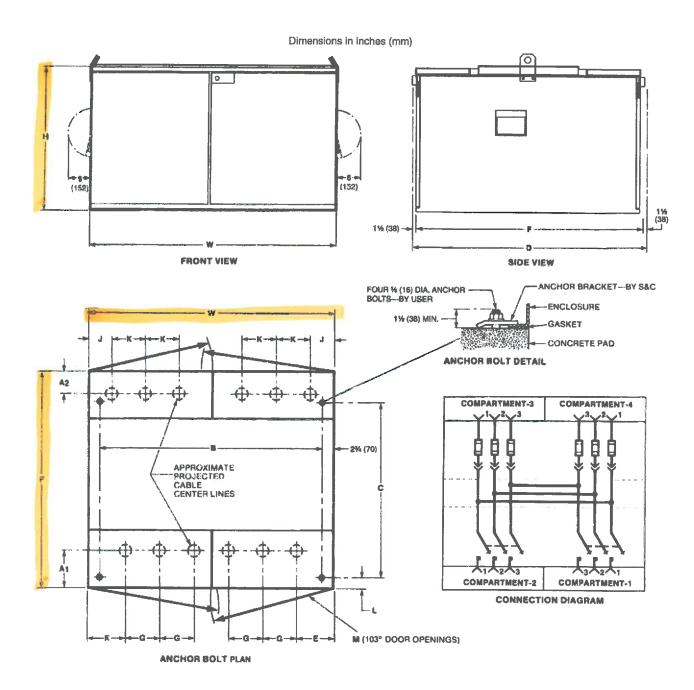

kV, Nominal	A ₁ •	A ₂	В	С	D	E	F	G	Н	J	К	L	М	W
14.4	14½	7	69½	49½	69¾	12%	66¾	8¼	45.5	5%	10¾	85%	38	75
	(368)	(178)	(1765)	(1257)	(1772)	(314)	(1695)	(210)	(1156)	(137)	(273)	(219)	(965)	(1905)
25	18½	81/s	78½	52	84¾	12%	81¾	8¼	51.5	6	12	147/s	42½	84
	(470)	(206)	(1994)	(1321)	(2153)	(327)	(2076)	(210)	(1308)	(152)	(305)	(378)	(1080)	(2134)

Projected cable center lines are applicable for PME models with cable installed in a cable pit. For cable installed in condult, refer to pages 22 and 23